

# CERTIFICATE

## of constancy of performance

### 1922 - CPR - 1786

In compliance with Regulation (EU) 305/2011 of the European Parliament and of the Council of 9 March 2011 (the Construction Products Regulation or CPR), this certificate applies to the construction product

**Fire detection and fire alarm systems. Control and indicating equipment. Power supply equipment. Fixed firefighting systems. Components for gas extinguishing systems. Electrical automatic control and delay devices. Manual triggering and stop devices, model BS-627 Fixed firefighting systems, Class A Fire extinguishing panel 4-zone with one extinguishing output**

(For list of controlled characteristics, see Annexes I, II, III and IV to 1922 - CPR - 1786 that are an inseparable part of this certificate)

placed on the market under the name or trade mark of

**Olympia Electronics N. Lakasas - P. Arvanitidis S.A**

**72nd km old highway Thessaloniki- Katerini, P.O. 60300, Eginio, Pieria, Greece**  
and produced in the manufacturing plant

**Olympia Electronics N. Lakasas - P. Arvanitidis S.A**

**72nd km old highway Thessaloniki- Katerini, P.O. 60300, Eginio, Pieria, Greece**

This certificate attests that all provisions concerning the assessment and verification of constancy of performance described in Annex ZA of the standards

**EN 54-2:1997, EN 54-2:1997/A1:2006, EN 54-2:1997/AC:1999; EN 54-4:1997, EN 54-4:1997/A1:2002, EN 54-4:1997/A2:2006, EN 54-4:1997/AC:1999; EN 12094-1:2003; EN 12094-3:2003;**


under system 1 for the performance set out in this certificate are applied and that the factory production control conducted by the manufacturer is assessed to ensure the constancy of performance of the construction product.

This certificate was first issued on 23.05.2022 and will remain valid until 23.05.2026 as long as neither the harmonised standard, the construction product, the AVCP methods nor the manufacturing conditions in the plant are modified significantly, unless suspended or withdrawn by the notified product certification body. The certificate is supported through annual surveillance audit and is reissued after each surveillance audit. The validity of the certificate may be confirmed in the CE register at the web address [www.dedal-bg.net](http://www.dedal-bg.net).



Manager:

*Banuba*



dipl. eng. Anna Vasileva

Issued:  
Burgas, 23 May 2023

Ref. No. 02-00

## ANNEX I TO CERTIFICATE OF CONSTANCY OF PERFORMANCE 1922 - CPR - 1786/23.05.2023

EN 54-2:1997, EN 54-2:1997/A1:2006, EN 54-2:1997/AC:1999

Essential Characteristics	Performance	Clause
<b>Performance under fire conditions</b>		
- General requirements	Pass	4
- General requirements for indications	Pass	5
- The fire alarm condition	Pass	7
<b>Response delay (response time to fire)</b>		
- Reception and processing of fire signals	Pass	7.1
- Output of the fire alarm condition	Pass	7.7
- Delay to outputs	N/A	7.11
- Dependencies on more than one alarm signal	N/A	7.12
<b>Operational reliability</b>		
- General requirements	Pass	4
- General requirements for indications	Pass	5
- The quiescent condition	Pass	6
- The fire alarm condition	Pass	7
- Fault warning condition	Pass	8
- Disabled condition	Pass	9
- Test condition	N/A	10
- Standardized input/output interface	N/A	11
- Design requirements	Pass	12
- Additional design requirements for software controlled control and indicating equipment	Pass	13
- Marking	Pass	14
<b>Durability of operational reliability, temperature resistance</b>		
- Cold (operational)	Pass	15.4
<b>Durability of operational reliability, vibration resistance</b>		
- Impact (operational)	Pass	15.6
- Vibration, sinusoidal (operational)	Pass	15.7
- Vibration, sinusoidal (endurance)	Pass	15.15
<b>Durability of operational reliability, electrical stability</b>		
- Electromagnetic compatibility (EMC), immunity tests (operational)	Pass	15.8
- Supply voltage variations	Pass	15.13
<b>Durability of operational reliability, humidity resistance</b>		
- Damp heat, steady state (operational)	Pass	15.5
- Damp heat, steady state (endurance)	Pass	15.14



Manager:

*Вануша*



dipl. eng. Anna Vasileva

## ANNEX II TO CERTIFICATE OF CONSTANCY OF PERFORMANCE 1922 - CPR - 1786/23.05.2023

EN 54-4:1997, EN 54-4:1997/A1:2002, EN 54-4:1997/A2:2006, EN 54-4:1997/AC:1999

Essential Characteristics	Performance	Clause
<b>Performance of power supply</b>		
- General requirements	Pass	4
- Functions	Pass	5
- Materials, design and manufacture	Pass	6
<b>Operational reliability</b>		
- General requirements	Pass	4
- Functions	Pass	5
- Materials, design and manufacture	Pass	6
- Documentation	Pass	7
- Marking	Pass	8
<b>Durability of operational reliability, temperature resistance</b>		
- Cold (operational)	Pass	9.5
<b>Durability of operational reliability, vibration resistance</b>		
- Impact (operational)	Pass	9.7
- Vibration, sinusoidal (operational)	Pass	9.8
- Vibration, sinusoidal (endurance)	Pass	9.15
<b>Durability of operational reliability, electrical stability</b>		
- Electromagnetic compatibility (EMC), immunity tests (operational)	Pass	9.9
<b>Durability of operational reliability, humidity resistance</b>		
- Damp heat, steady state (operational)	Pass	9.6
- Damp heat, steady state (endurance)	Pass	9.14



Manager:

*Anna Vasileva*



dipl. eng. Anna Vasileva

**ANNEX III TO CERTIFICATE OF CONSTANCY OF PERFORMANCE  
1922 - CPR - 1786/23.05.2023**

EN 12094-1:2003

Essential Characteristics	Performance	Clause
<b>Response Delay (response time)</b>		
- Activated condition	Pass	4.8
- Functional requirements	Pass	4
- Design requirements	Pass	5
- Additional design requirements for software controlled e.c.d.s	Pass	6
<b>Performance Parameters Under Fire Condition</b>		
- Signal processing and indication	Pass	4.3
- Reception and processing of input triggering signals	Pass	4.4
- Transmission of extinguishing signal	Pass	4.5
- Activation of alarm devices	Pass	4.6
<b>Tests</b>		
- Durability	Pass	9

This certificate was first issued on 23.05.2022 and will remain valid until 23.05.2026 as long as neither the harmonised standard, the construction product, the AVCP methods nor the manufacturing conditions in the plant are modified significantly, unless suspended or withdrawn by the notified product certification body. The certificate is supported through annual surveillance audit and is reissued after each surveillance audit. The validity of the certificate may be confirmed in the CE register at the web address [www.dedal-bg.net](http://www.dedal-bg.net).


Manager:   
dipl. eng. Anna VasilevaIssued:  
Burgas, 23 May 2023  
Ref. No. 02-00

## ANNEX IV TO CERTIFICATE OF CONSTANCY OF PERFORMANCE 1922 - CPR - 1786/23.05.2023

EN 12094-3:2003

Essential Characteristics	Performance	Clause
<b>Operational reliability</b>		
- Non- electrical triggering devices- General design	Pass	4.2.1
- Pressure	N/A	4.2.2
- Strength	N/A	4.2.3
- Operational reliability	Pass	4.2.5
- Vibration	Pass	4.2.8
<b>Performance Parameters Under Fire Condition</b>		
- Function and ambient temperatures	Pass	4.2.4
- Operating force	Pass	4.2.9
<b>Durability of operational reliability against corrosion</b>		
- Corrosion	Pass	4.2.6
- Stress corrosion	N/A	4.2.7

This certificate was first issued on 23.05.2022 and will remain valid until 23.05.2026 as long as neither the harmonised standard, the construction product, the AVCP methods nor the manufacturing conditions in the plant are modified significantly, unless suspended or withdrawn by the notified product certification body. The certificate is supported through annual surveillance audit and is reissued after each surveillance audit. The validity of the certificate may be confirmed in the CE register at the web address [www.dedal-bg.net](http://www.dedal-bg.net).

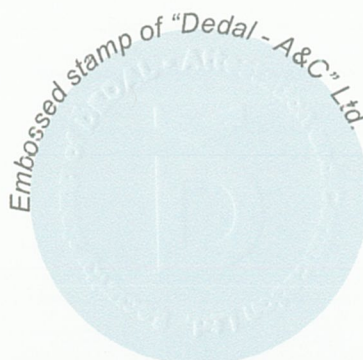

Manager: *Anna Vasileva*  
Dedal dipl. eng. Anna Vasileva

Issued:  
Burgas, 23 May 2023  
Ref. No. 02-00